



Ceiling mount installation

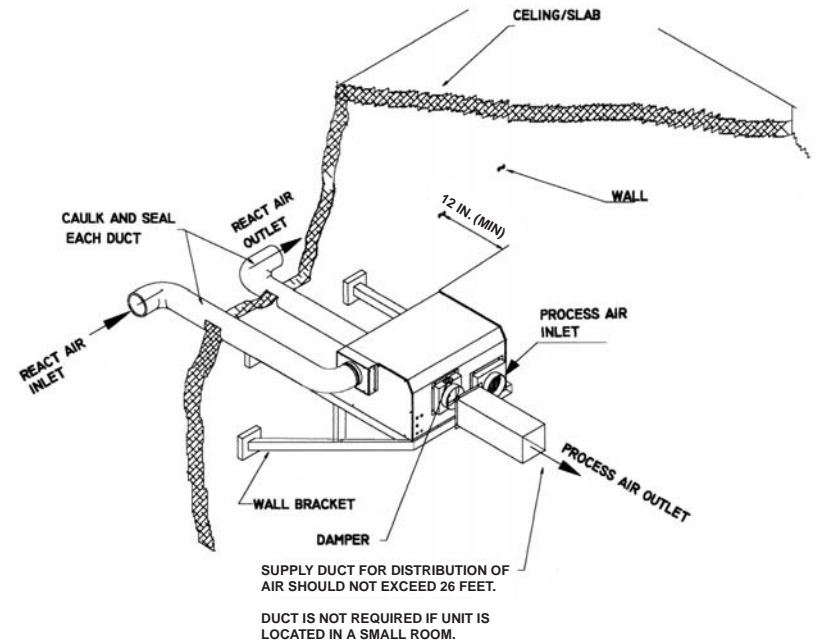

Wall mount installation

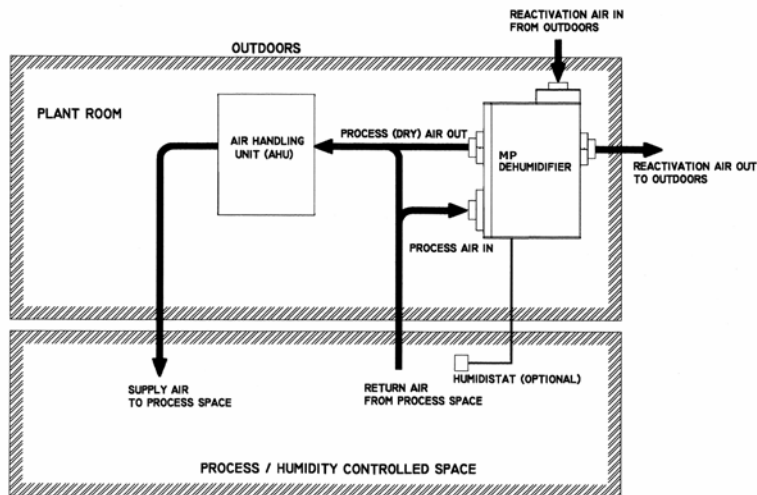

Installation with air handling unit

When installed like the illustration shown to the left, Bry-Air suggests that for more consistent conditions, the cooling fan and the dehumidifier fan should be wired for continuous operation.

MiniPAC
TYPICAL
INSTALLATION



Bry-Air, Inc.
10793 St. Rt. 37 W
Sunbury, Ohio 43074
Phone: 740-965-2974
Toll Free: 877-4BRYAIR
Toll Free: 877-427-9247

Fax: 740-965-5470